




- Towns
- Existing 330kV MacIntyre Overhead Transmission Line (OHTL)
- Existing MacIntyre Switching Station
- Project Boundary
- Permanent Infrastructure**
 - Wind Turbine Generator
 - Wind Monitoring Mast
 - OHTL Option A - Canning Creek Switching Station and cut in
 - OHTL Option B - Macintyre Switching Station connection
 - Operations and Maintenance Facility
 - Substation North
 - Substation South
 - Switching Station
 - BESS
- Temporary Infrastructures**
 - Batch Plants
 - Main Construction Compound
 - Satellite Construction Compound
 - Site Offices
 - Site Offices (Alternate)
 - Accommodation Camp

ACCIONA Energia makes no representation or warranty as to the accuracy or completeness of the information contained in the plans. Recipients must make their own assessment and form their own views in light of their particular circumstances. Recipients must keep the information confidential and not use it for any other purpose. Recipients expressly waive any right they may have to rely on the information and agree not to rely upon it or sue or hold any of Acciona Energia or its related parties, officers, employees or advisers liable in any respect. Recipients must bear their own costs or expenses in reviewing, investigating or analysing the information. These plans are not intended to create any legal obligations on ACCIONA Energia.

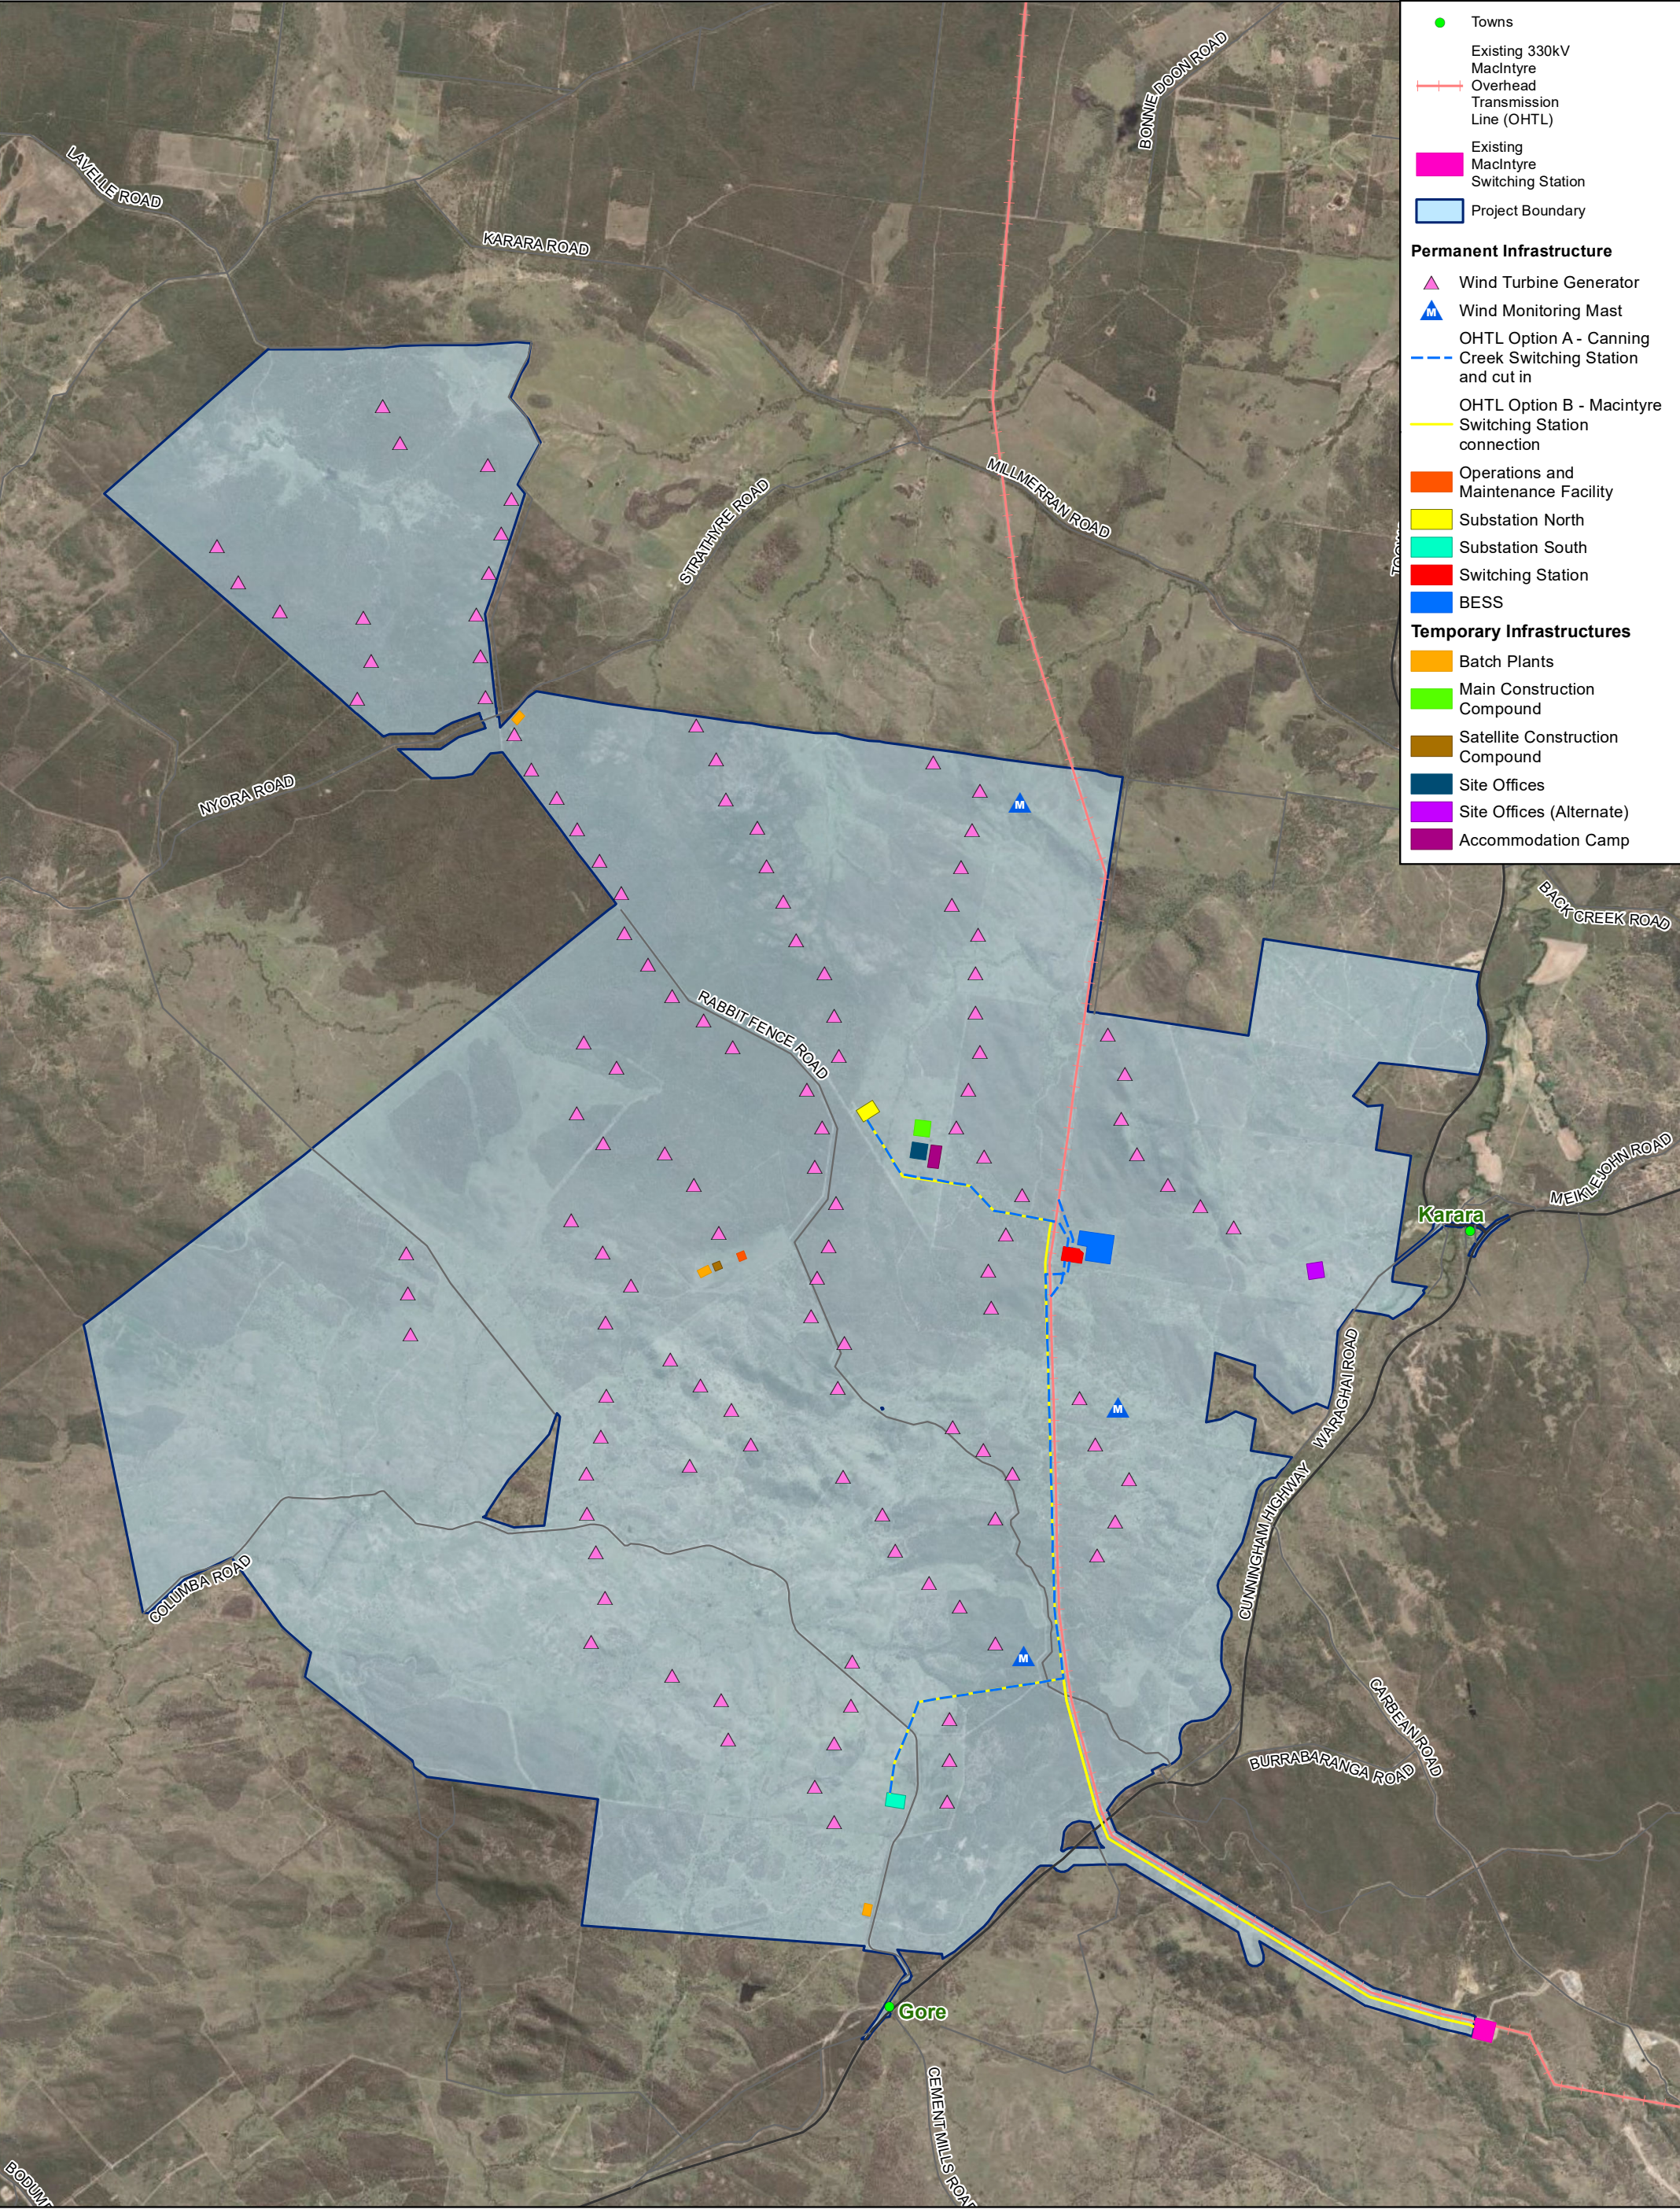